



KW2M SERIES





# Monitoring various parameters with one power meter!

Equipped with multi functionalities and two Ethernet ports









# Expansion units and two Ethernet ports allow you


# Wire-saving and space-saving

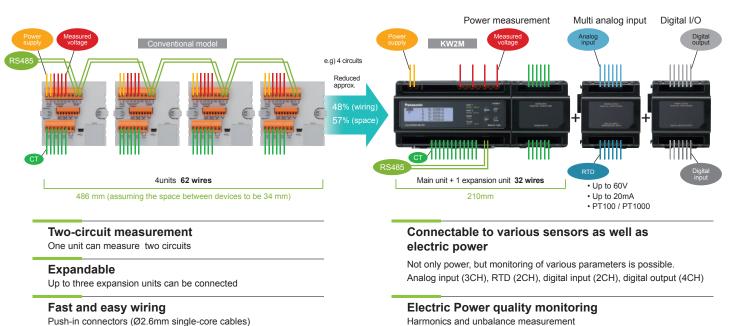

# Application Factory

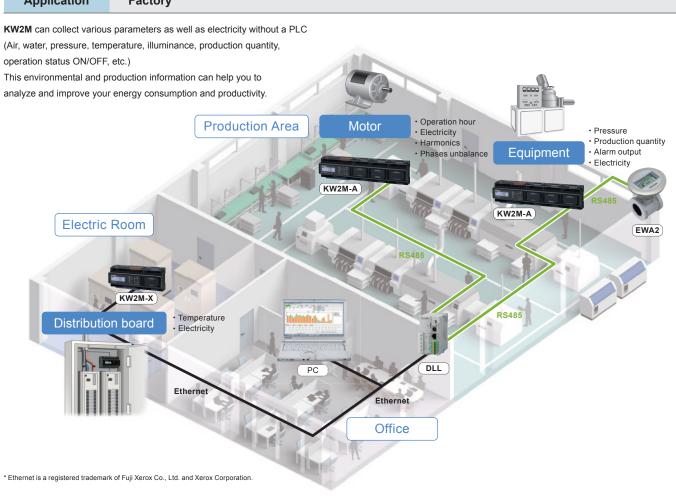

# to optimize your energy consumption

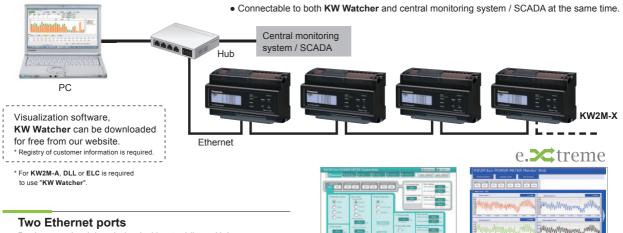

Devices can be daisy-chained without adding a Hub

# Internal memory (only KW2M-X)

Measured data can be saved in CSV files and visualized by **KW Watcher** 

### Web server functionality

Operational settings on the PC via Ethernet cable. Also real-time monitoring is possible with **KW2M-X**.

\* Ethernet is a registered trademark of Fuji Xerox Co.,Ltd. and Xerox Corporation.

### Function comparison (for KW2M-A and KW2M-X)

Operational setting


Function		Product name			
	Function	KW2M-A	KW2M-X		
Logging		Not available	Available (CSV format)		
Web Creator Integral power for each time zone Demand saved data		Not available	Available		
		Not available	Available (4-zone)		
		Available (Only Max. demand)	Available (Monthly max.demand 12 records(12-month))		

Real-time monitoring (KW2M-X only)

# **Application**

# **Building / Commercial complex**

e. treme

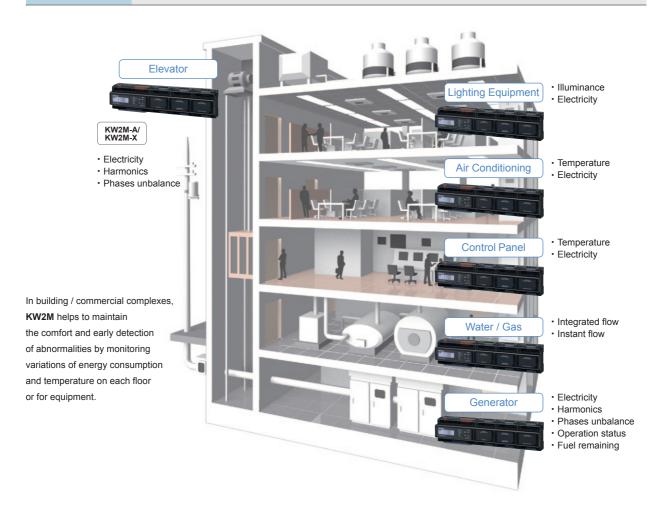


# to monitor various parameters via Ethernet


# Web Creator (KW2M-X)



By uploading user-defined screens (content) with Control web Creator to the web server integrated in the KW2M-X, users can monitor the information in a browser

\* The data of KW2M-A can be also displayed when connected to KW2M-X via Ethernet.

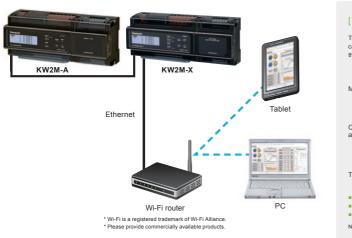


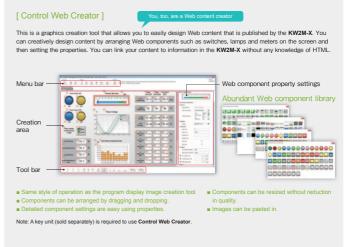

# Application

# Remote network monitoring

Thanks to Ethernet communication functionality, the server can collect remote data through the **KW2M**. This reduces the cost and time needed for monitoring each remote site.

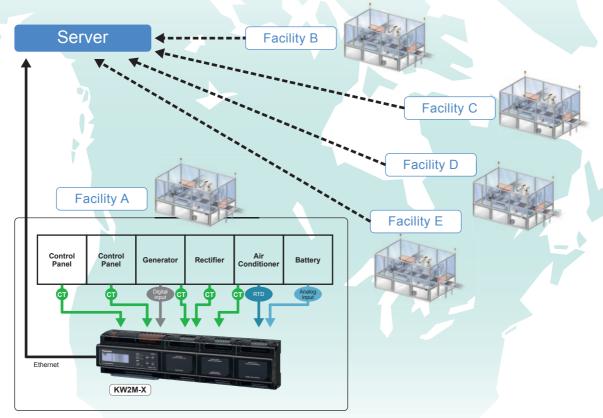

<sup>\*</sup> Ethernet is a registered trademark of Fuji Xerox Co., Ltd. and Xerox Corporation

# Application examples of expansion units

# Predictive maintenance of storage battery

(Multi analog input unit)


Measure the DC voltage to get information about when the battery is deteriorated and needs to be replaced. This helps with maintenance planning.



# Predictive maintenance of panel

(Multi analog input unit)

By measuring the temperature inside electrical cabinet at the transformer, you can easily determine when it is time for maintenance.

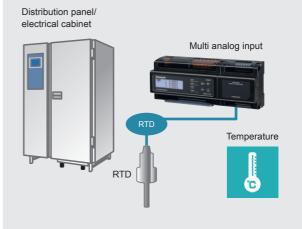

# Alarm output


(Digital I/O unit)

# Integrated flow data monitoring is possible using the digital I/O unit. You can also output the alarm when an error occurs. Alarm output Digital I/O Digital I/O Digital input flow

# Elimination of voltage imbalances between phases

(Power measurement unit)

If there is an unbalanced load due to a V-connected transformer or a heater, a voltage imbalance occurs between phases, and the motor torque becomes insufficient, causing a rise in heat or a reduction in product life.



# **Product Types and Specifications**

### Order guide

Product name		Phase and wire system	Operating power supply	Input measured voltage	Applicable current transformer *1	Model No.	
	14.1	KW2M-A (standard type)		100-240V AC		CT with secondary side output	AKW263100A
	Main unit	KW2M-X (memory type)					AKW264100A
		Power measurement	Three-phase three-wire system Three-phase four-wire system	50 / 60 Hz	supported 0-300V AC	1A or 5A	AKW272100A
KW2M-A/KW2M-X		unit	Number of input points		Input range		
Eco-POWER METER	Expansion		Analog input (Voltage/Curret) 3 cha	innels	0-60 V, 0-20 mA, 4-20 mA		AKW273230A
	unit		Resistance temperature detector input (RTD) 2 channels		PT100 / PT1000		
			Number of I/O points		Input method		AKW274240A
	Digital I/O	Digital I/O	Pulse input 2 channels, Pulse outp	ut 4 channels	Contact / non-voltage a contact	or open-collector	ANTIL 4240A

<sup>\*1</sup> Dedicated current transformer (CT) cannot be used. Please use a general-purpose CT with a secondary side current 1A or 5A.

### ■ Specifications

General specifications					
Item		Specification			
Supply vo	Supply voltage range		100-240V AC		
Rated f	requency	50 / 60Hz			
Nominal pow	er consumption	15VA approx. (240V AC at	25°C)		
Inrush	current	30A or less (240V AC/DC	at 25°C)		
Allowable momen	ntary power-off time	10ms			
Ambient t	omnoraturo	Operation	-10 to +50°C		
Ambient	emperature	Storage	-25 to +70°C		
Ambien	t humidity	30 to 85%RH (at 20°C) no	n-condensing		
		Between the isolated circu	its: 2,000V / 1min		
Breakdown voltage (initial)		a) enclosure ↔ all terminals b) primary insulated circuits ↔ secondary insulated circuits (Double insulation) • power supply terminals ↔ other terminals • voltage input terminals ↔ other terminals			
Insulation resistance (initial)		Between the isolated circuits: 100 MΩ or more			
Vibration	resistance	10 to 150Hz (7.5 minutes/cycle) single amplitude:0.075mm (1h on 3 axes)			
VIDIALIOII	resistance	10 to 55Hz (1 minute/cycle) single amplitude:0.375mm (1h on 3 axes)			
Shock r	Shock resistance		Min. 294m/s² (5 times on 3 axes)		
Display	Display method				
Display updated cycle		500, 1,000, 2,000, 3,000 m	s (set with setting mode)		
Power failure memory method (when power is off)		Internal memory			
Sea lev	Sea level altitude				
Overvoltage category		III			
Pollutio	n degree	2			
Dimonoi	ons W/H/D	Main unit	85 x 140 x 65 mm		
Dimensio	JIIS VV/IT/U	Expansion unit	85 x 70 x 65 mm		
		Main unit	450 g approx.		
We	eight	Expansion unit (Power measurement)	200 g approx.		
		Expansion unit (Digital I/O, Multi analog input)	140 g approx.		
	Range	January 1, 2015 00:00:00 to December 31, 2099 23:59:59 (leap year supported)			
Calender timer *1	Time accuracy	Monthly accuracy Max. 15 sec. (at 25°C)			
	Back up period	About 1 month  ( by secondary battery when power off after 48-hours or more of power on time, at 23°C			

<sup>\*1</sup> only KW2M-X

### Measurement items (for AKW263100A, AKW264100A and AKW272100A)

Item			Display data range	
Instantaneous power (Active, Reactive, Apparent)		tive, Reactive, Apparent)	-999.99P to 999.99P (W, var, VA)	
Total integral power (import) (Active, Reactive, Apparent)			0.000k to 9999.9P (Wh, varh, VAh)	
	Total integral power (ex	port) (Active, Reactive)	0.000k to 9999.9P (Wh, varh)	
	Cur	rent	0.000 to 999.99k (A)	
	Volt	age	0.00 to 9999.9k (V)	
	Power	factor	-1.000 to 0.000 to 1.000	
	Frequ	iency	0.00 to 99.99 (Hz)	
	Pulse co	unt value	0.000 to 999999	
Power conversion value		ersion value	0.000k to 9999.9P	
	Leakage current		0.0000 to 99999.9999 (A)	
	Unbalanced current (Each phase)		0.00 to 300.00 %	
₹	Unbalanced voltage (Each phase)		0.00 to 300.00 %	
ual	Current THD (total harmonic distortion) (Each phase)		0.00 to 400.00 %	
er q	Voltage THD (total harmonic distortion) (Each phase)		0.00 to 400.00 %	
Power quality	Current harmonics (2nd to 31st ) (Each phase)		0.00 to 400.00 %	
ď	Voltage harmonics (2nd to 31st ) (Phase, Line)		0.00 to 400.00 %	
	Hour Meter (ON-time, OFF-time, Stand-by time, Maintenance time)		0.0 to 99999.9 h	
	Present demand *1	Active, Reactive, Apparent, Active (export), Reactive (export)	0.000k to 999.99M (W, var, VA)	
		Current	0.000k to 999.99k (A)	

### Accuracy (for AKW263100A, AKW264100A and AKW272100A)

Item		Specifications
Electrical power	±0.5%	Active power Compliant Class 0.5S (IEC 62053-22) Reactive power Compliant Class 2 (IEC 62053-23)
Current	±0.2% *1 ±0.5% for 2(N)-phase of 1P3W and 2(S)-phase of 3P3W	
Voltage	±0.2%	±0.5% for 2-phase of 1P3W, 3-1 voltage of 3P3W and line voltage of 3P4W.

<sup>\*1</sup> When it measures current under 5% of rating, it may not satisfy the accuracy according to setting of CT. (Max.error 0.5%) The tolerance of CT sensor and VT(instrument voltage transformer) are not included.

### Output specifications (for AKW263100A, AKW264100A and AKW274240A)

Item		Specifications	
Number of subsubscript	Main unit	2 points (insulate between output terminals)	
Number of output point	Expansion unit (Digital I/O)	4 points (insulate between output terminals)	
Insulation method		MOSFET relay	
Output type		1a	
Output capacity		100mA, 30V AC/DC	
Output mode (OUT1/OUT2)		Pulse by integral power     Output by alarm or events (set with setting mode)	

### Digital input specifications (for AKW263100A, AKW264100A and AKW274240A)

Item		Specifications		
	Main unit	1 point		
Number of input point	Expansion unit (Digital I/O)	2 points		
Insulation	n method	Designated ins	Designated insulation for input (insulate to the other functions)	
Input r	nethod	Contact/ nor	n-voltage a contact or open-collector	
Input signal		Non-voltage	Impedance; Max. 1kΩ (when short-circuit current: Max. 10mA) Residual voltage when shorted; Max. 3V Impedance when open: Min. 100kΩ	
Input mode		Pulse input Synchronized with input from outer device *1 Measure maintenance time *1		
Max. counting speed		2000Hz / 30Hz		
Min. input signal width		0.25ms (wher ON:OFF ratio	n 2000Hz is set) / 16.7ms(when 30Hz is set) =1:1	

# Analog input specifications (for AKW273230A)

		· · · · · · · · · · · · · · · · · · ·	
Item		Specifications	
Input channel		3 channels	
Input range (slect with setting mode)	Voltage	0 to 60V	
input range (slect with setting mode)	Current	0 to 20mA / 4 to 20mA (set with setting mode)	
Resolution		24bit	
Total accuracy		Within ±0.1%F.S.(at 25°C), Within ±0.3%F.S.(at -10 to 50°C)	

# RTD input specifications (for AKW273230A)

Item			Specifications
Input channel		2 channels	
Input range		PT100	-200.0 to +200.0°C
		PT1000	-200.0 to +200.0°C
Resolution (24bit)		0.1°C	
	CH1	Within ±0.3%F.S.(at 25°C), Within ±0.5%F.S.(at -10 to 50°C)	
Total accuracy	CH2	Within ±0.5%F.S.(at 25°C), Within ±1.0%F.S.(at 10 to 40°C), Within ±1.5%F.S.(at -10 to 50°C)	

### Standard

	Certified by TÜV Rheinland (NRTL), UL61010-1:2012, CAN/CSA-C22.2 No.61010-1-12
CE	EN61326-1:2013, EN61010-1:2010

2018.01 panasonic.net/id/pidsx/global

# Panasonic Industrial Devices SUNX Co., Ltd.

measured.

\*If the voltage to be measured is not the rated frequency (commercial frequency), it may take time to stabilize THD (total harmonic distortion).

\*1 Please use this demand function as your standard.

The demand value calculated with this function is not guaranteed.